


NOTE : METERS SHALL BE IN
THE SIDEWALK AREA OF R.O.W.
IF POSSIBLE AND CURB VALVE
CLOSE TO CURB IN SIDEWALK

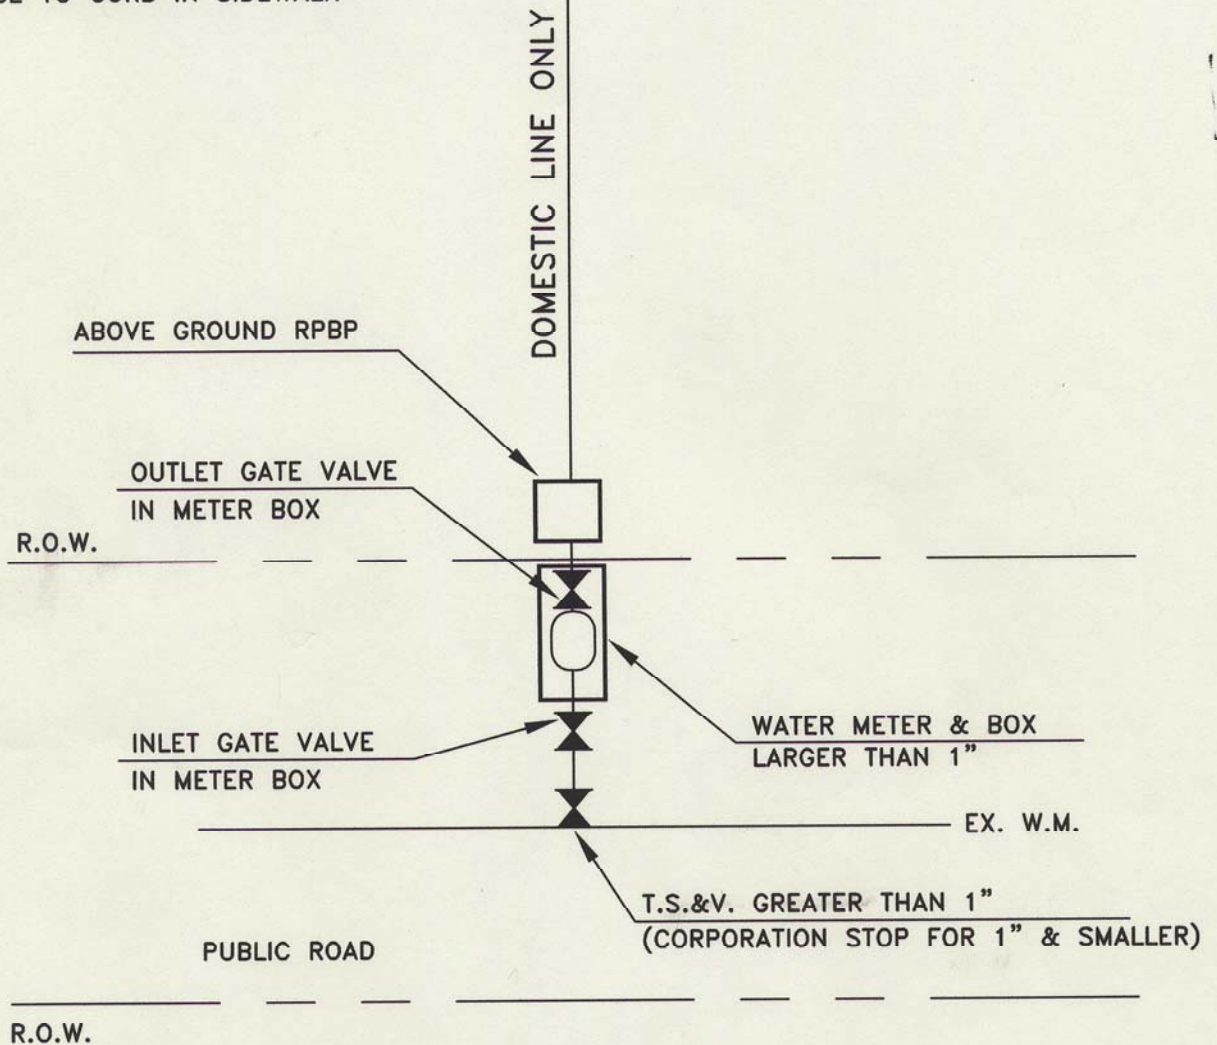

METRO WATER SERVICES

LARGER THAN 1"
DOMESTIC WATER LINE ONLY

NOT TO SCALE | DATE: 2/25/05

DWG. NO. SCHEMATIC 1

METRO
WATER SERVICES

Hal Balthrop
LICENSED DISTRIBUTION OPERATOR

[Signature]
DIRECTOR OF WATER AND SEWERAGE SERVICES